

TXModBusRTUraw

Mod Bus RTU Raw Client "Master"

Using :

For Multi Port Mod Bus RTU Communication

SubObjects :

TXPlcMTag

Tag for Read And Write Registers

Commands :

Start

Start Communication With PLC

Propertyes :

Value

Link Point

AutoStart

Start After Run

ActiveLed

TXLedP

AlarmError

TXAlarm

AlarmInfo

TXAlarm

ReadTagCount

Maximum Tag Read in One Transaction

Delay

Slow down communication for debug (ms.)

ComFaults

Communication Fault Counter

TimeOut


Read Time Out

BaseRegister

0 , 1 , -1

Offset RTU addresses of registers

Tools

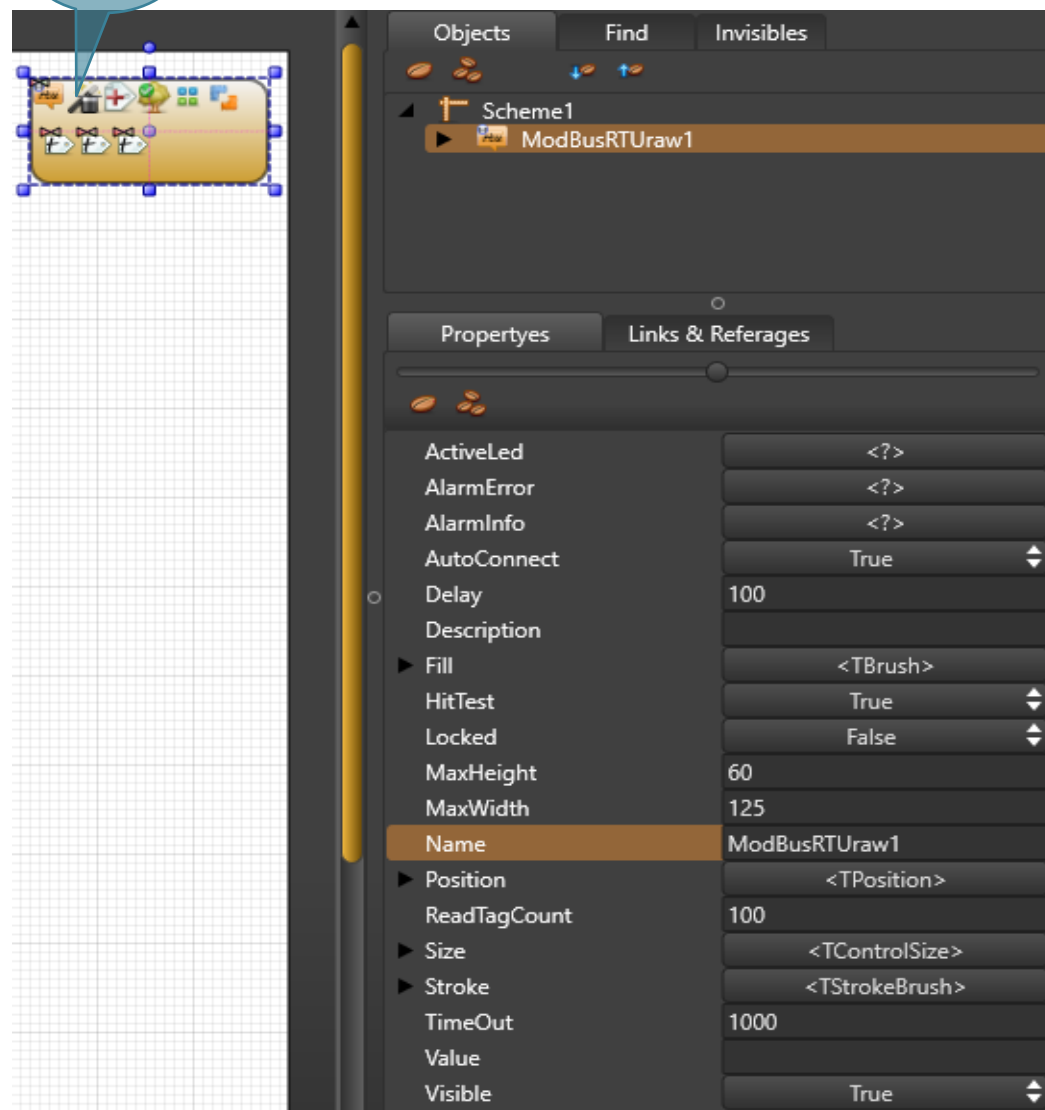

Connect

