

ModBusTCPClient

Mod Bus TCP Client "Master"

Using :

For Mod Bus TCP Communication

SubObjects :

TXPlcMTag

Tag for Read And Write Registers

Commands :

Start

Start CommunicationWith PLC

Properties :

BaseRegister

0 , 1 , -1

Offset TCP addresses of registers

AutoStart

Start After Run

ActiveLed

TXLedP

AlarmError

TXAlarm

AlarmInfo

TXAlarm

ReadTagCount

Maximum Tag Read in One Transaction

UnitID

Unit ID

Delay

Slow down communication for debug (ms.)

ComFaults

Communication Fault Counter

TimeOut

Read Time Out

Devicelp

Connect To PLC Time Out

DevicePort


PLC IP

ReconnectDelay

PLC Port

if Disconnect Retry Connect

Tools

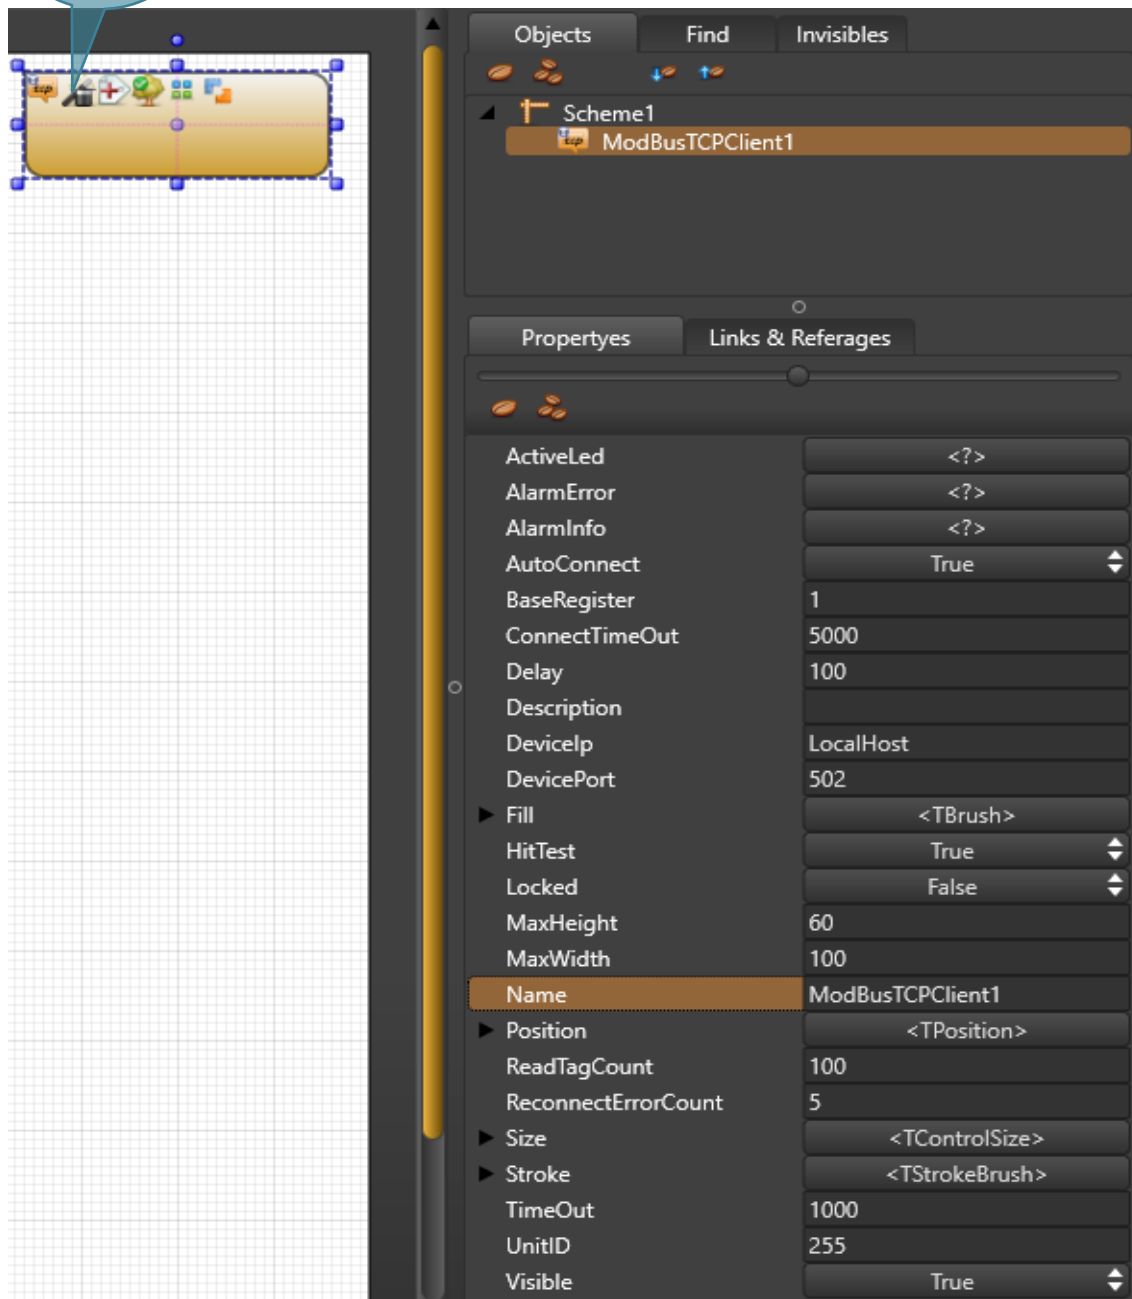

Connect

