

TXModBusRTUClient

Mod Bus RTU Client "Master"


Using :
For Mod Bus RTU Serial Communication

SubObjects :
TXPlcMTag Tag for Read And Write Registers

Commands :
Start Start Communication With PLC

Propertyes :
AutoStart Start After Run
ActiveLed TXLedP
AlarmError TXAlarm
AlarmInfo TXAlarm
ReadTagCount Maximum Tag Read in One Transaction
Delay Slow down communication for debug (ms.)
ComFaults Communication Fault Counter
TimeOut Read Time Out
Port Com1 , Com2 ...
BautRate 9600 ...
ParityBits prNone, prOdd, prEven, prMark, prSpace
DataBits dbSeven,dbEight
StopBits sbOneStopBit, sbTwoStopBits
BaseRegister 0 , 1 ,-1
Offset RTU addresses of registers

Tools

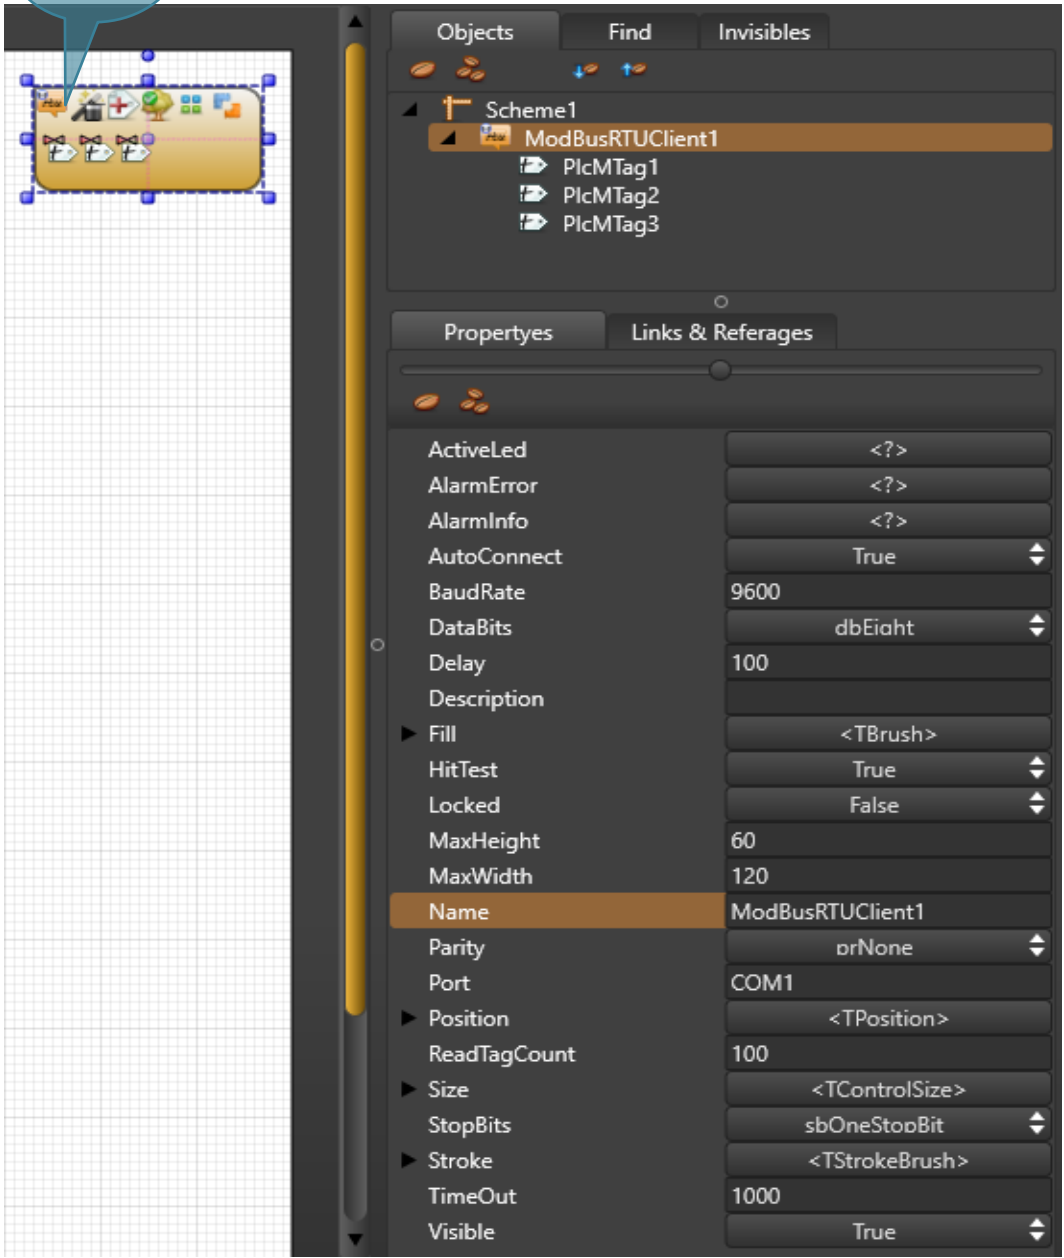

Connect



ModBusRTU
Client

